



External Dimension

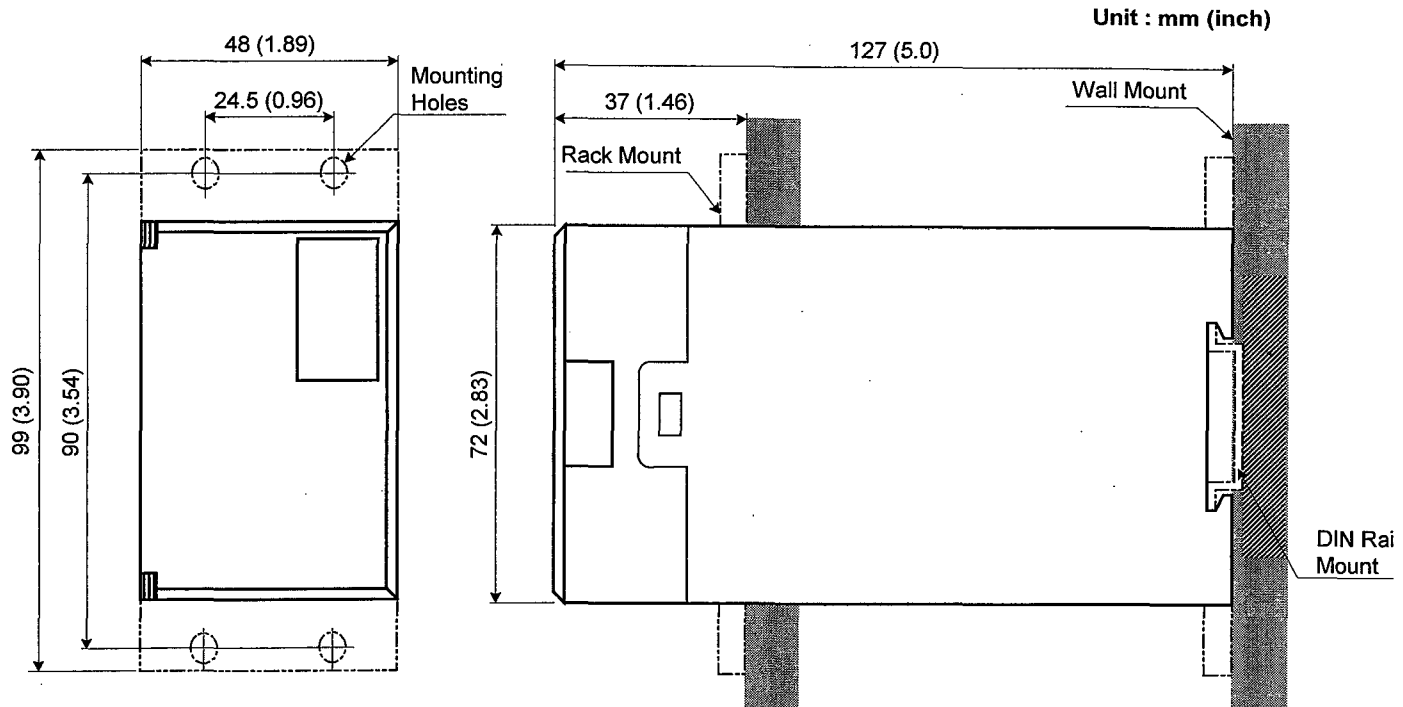

Terminal Arrangement

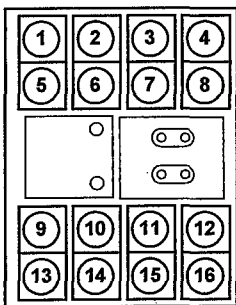

Terminal		
①	Primary alarm output	NC
②	Primary alarm setting monitoring	
③	Primary alarm lockup width monitoring	
④		
⑤	Primary alarm output	COM
⑥	Primary alarm output	NO
⑦	Input signal	+
⑧	Input signal	-
⑨	Secondary alarm output	COM
⑩	Secondary alarm output	NO
⑪	Secondary alarm setting monitoring	
⑫	Secondary alarm lockup width monitoring	
⑬	Secondary alarm output	NC
⑭	Supply	L+
⑮	Supply	N-
⑯	GND	G