



SD 77C01E01-01E


ANSI 4-inch round form size (when a bezel is attached)

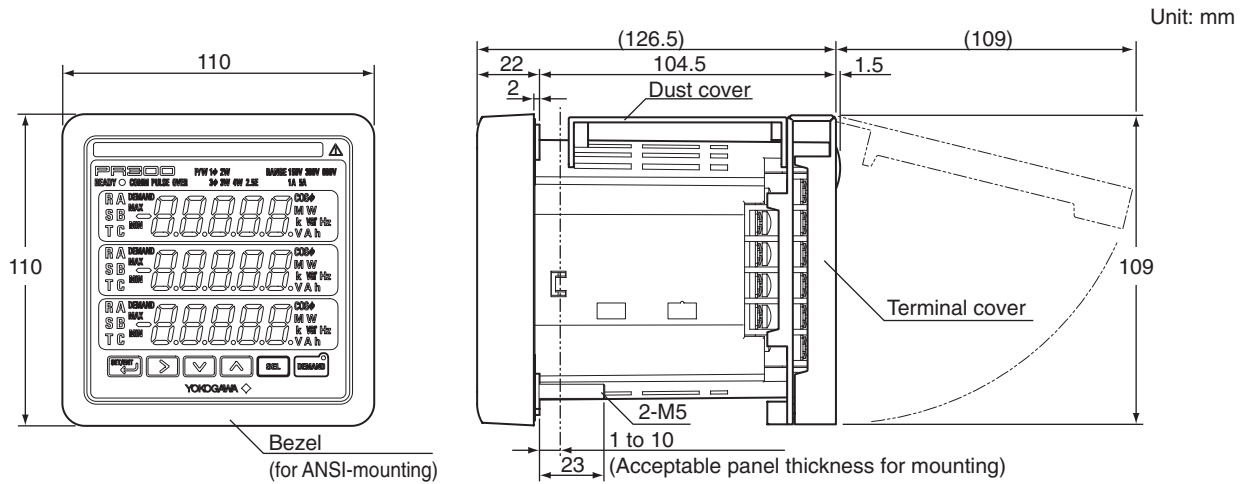


● Panel Cutout Dimensions

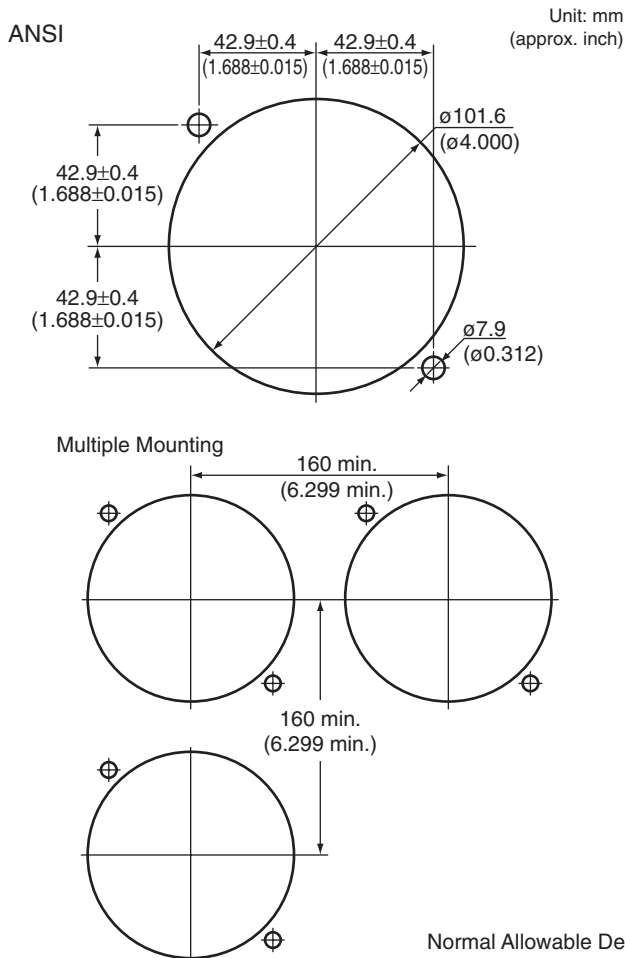

DIN 96-square instrument size

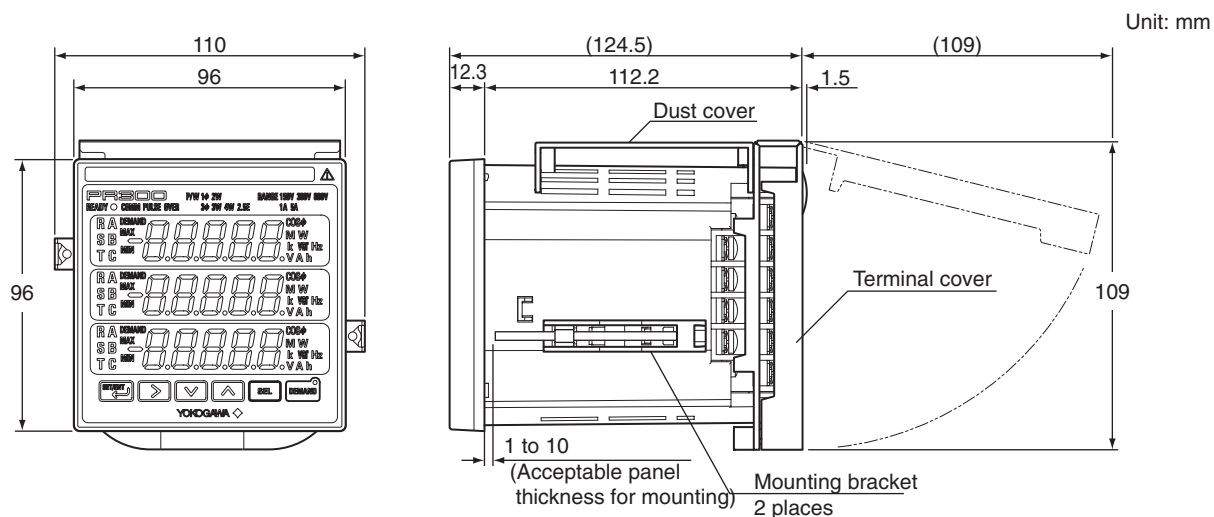


● Panel Cutout Dimensions

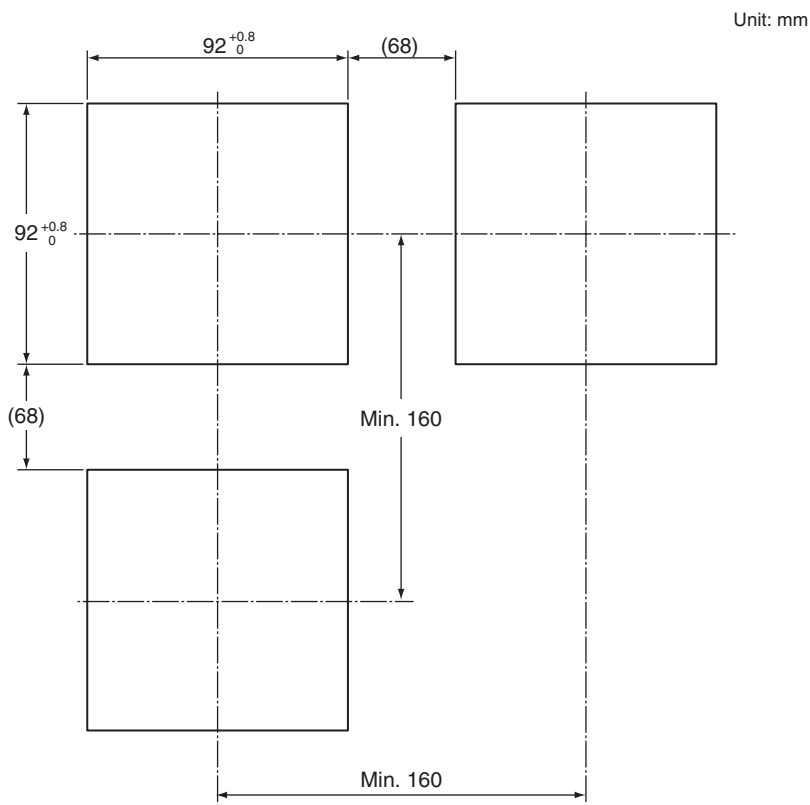

Normal Allowable Deviation= ±(Value of JIS B 0401-1999 tolerance grade IT18)/2

Connection Diagrams

● Single-phase two-wire system

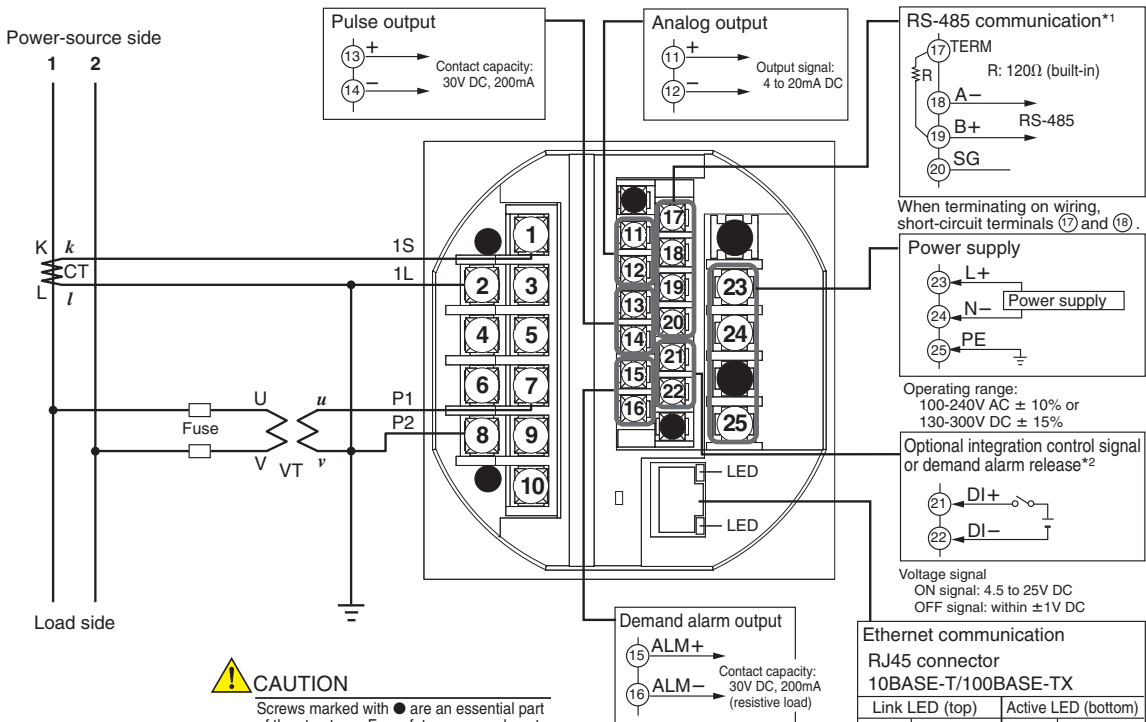


CAUTION
 Screws marked with ● are an essential part of the structure. For safety reasons, do not touch them.

*1: If Ethernet communication is used, the RS-485 communication interface is used specifically for the Ethernet-serial gateway function.


*2: If demand measurement is specified, the demand alarm release is selected.

Switching between 10BASE-T and 100BASE-TX takes place automatically.
 Switching between half duplex and full duplex takes place automatically.


● Single-phase three-wire system

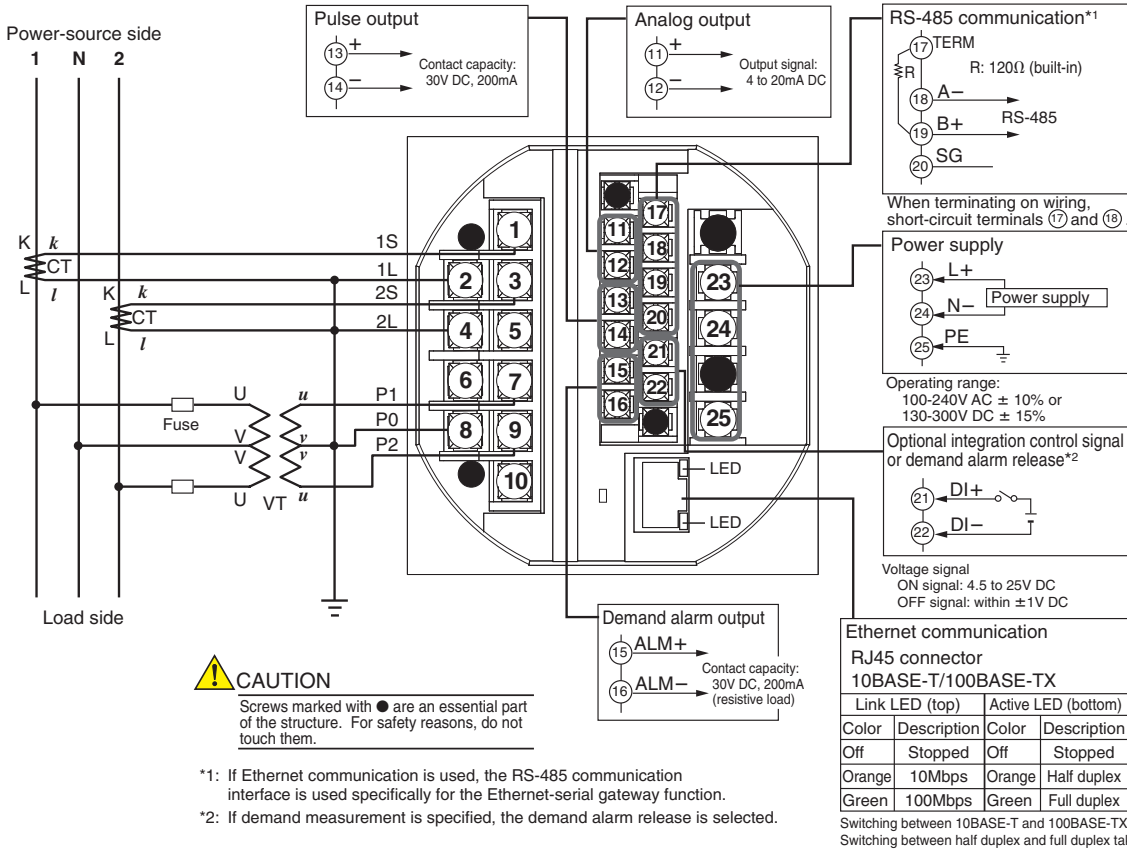

● Three-phase three-wire system

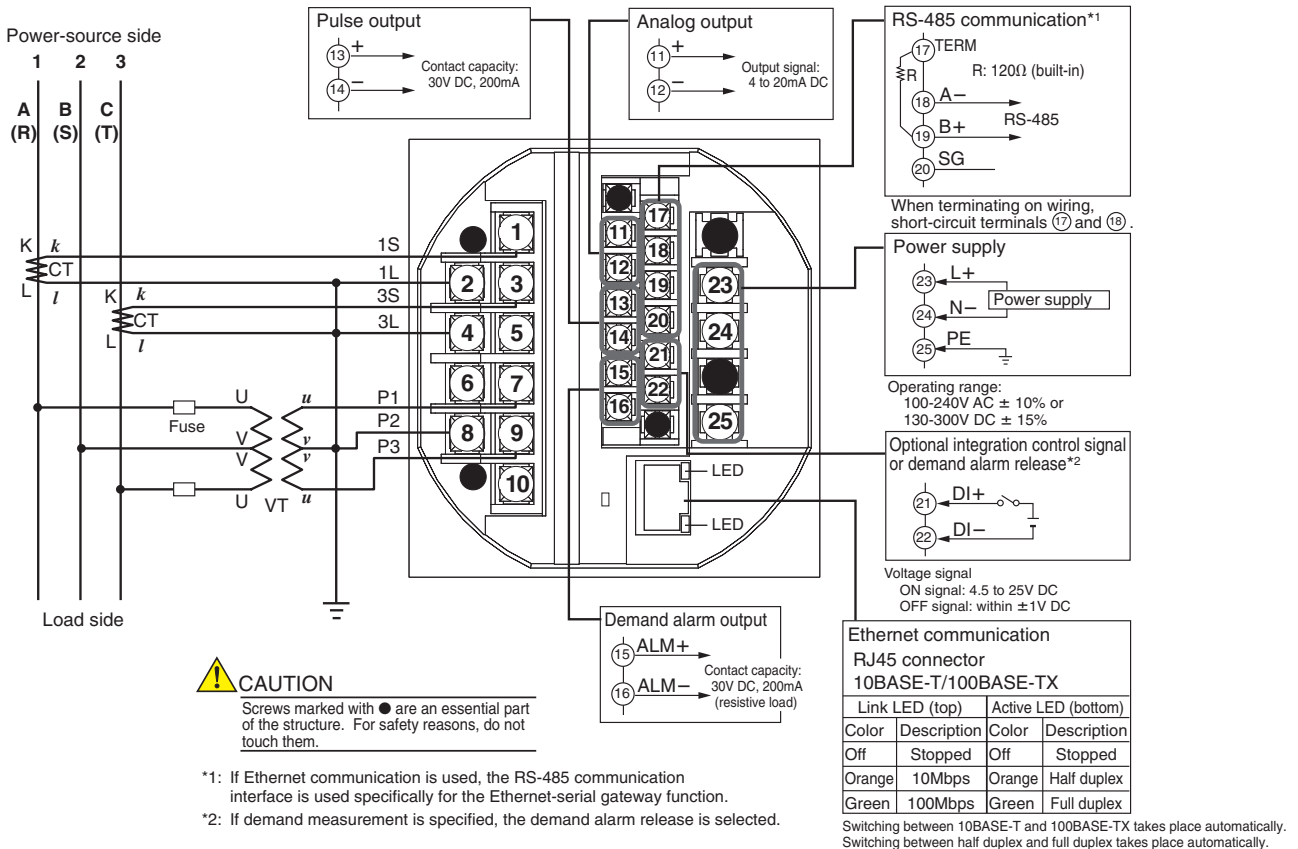

● Three-phase four-wire system

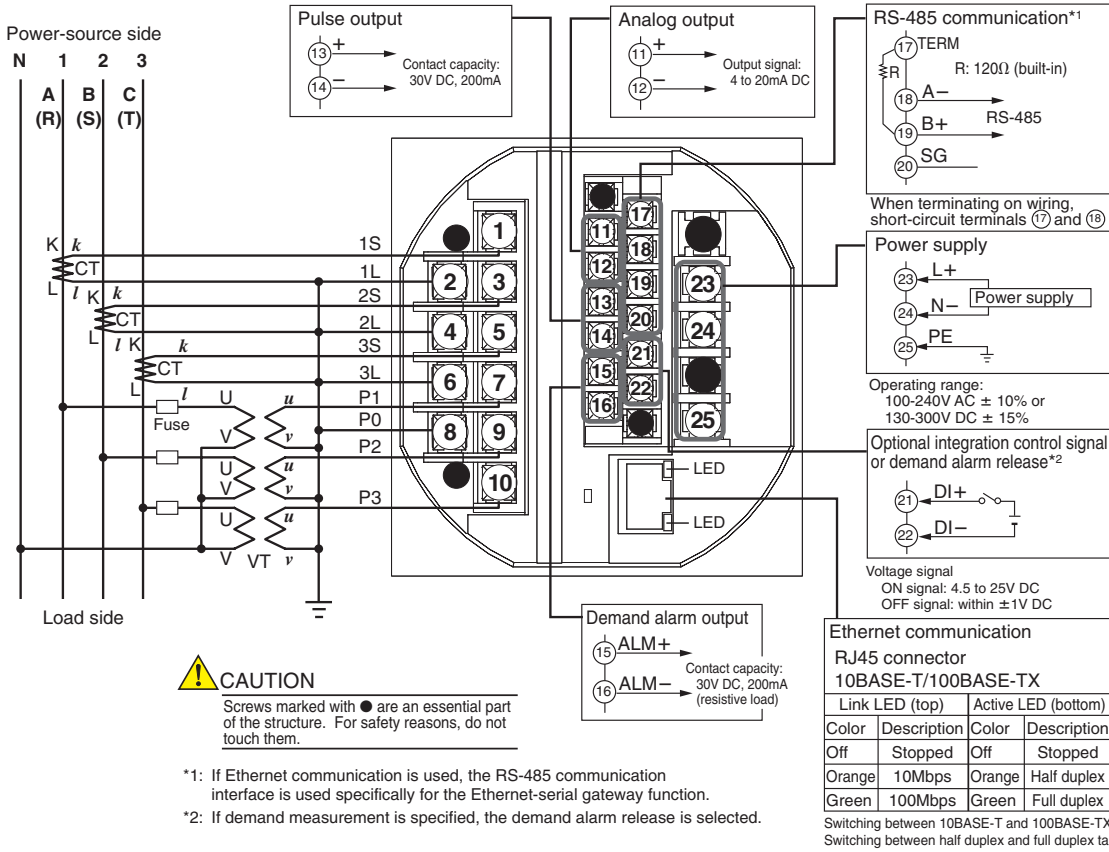

● Three-phase four-wire system (2.5 element)

